


Tier I and Tier II Malfunctions

n = 140

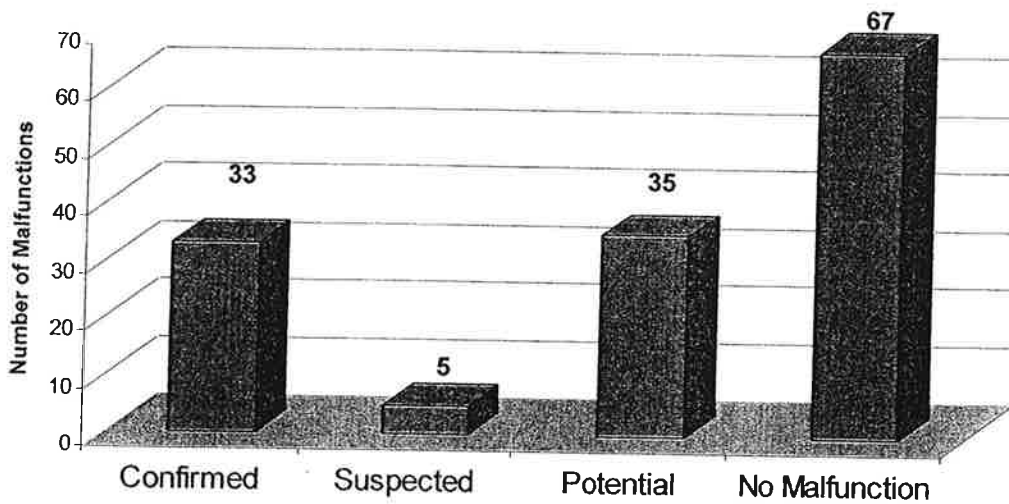

Tier I and Tier II Malfunctions

n = 140

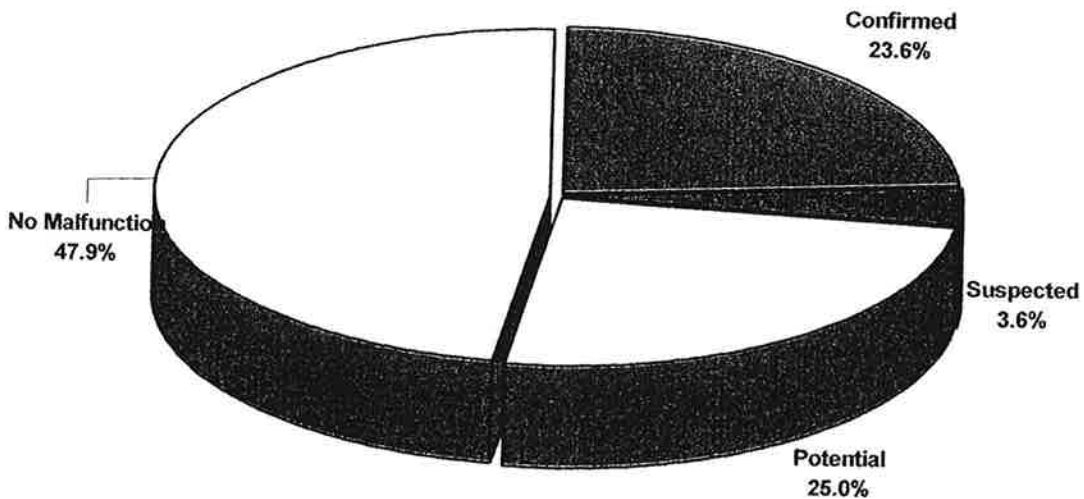


FIGURE 3-4a



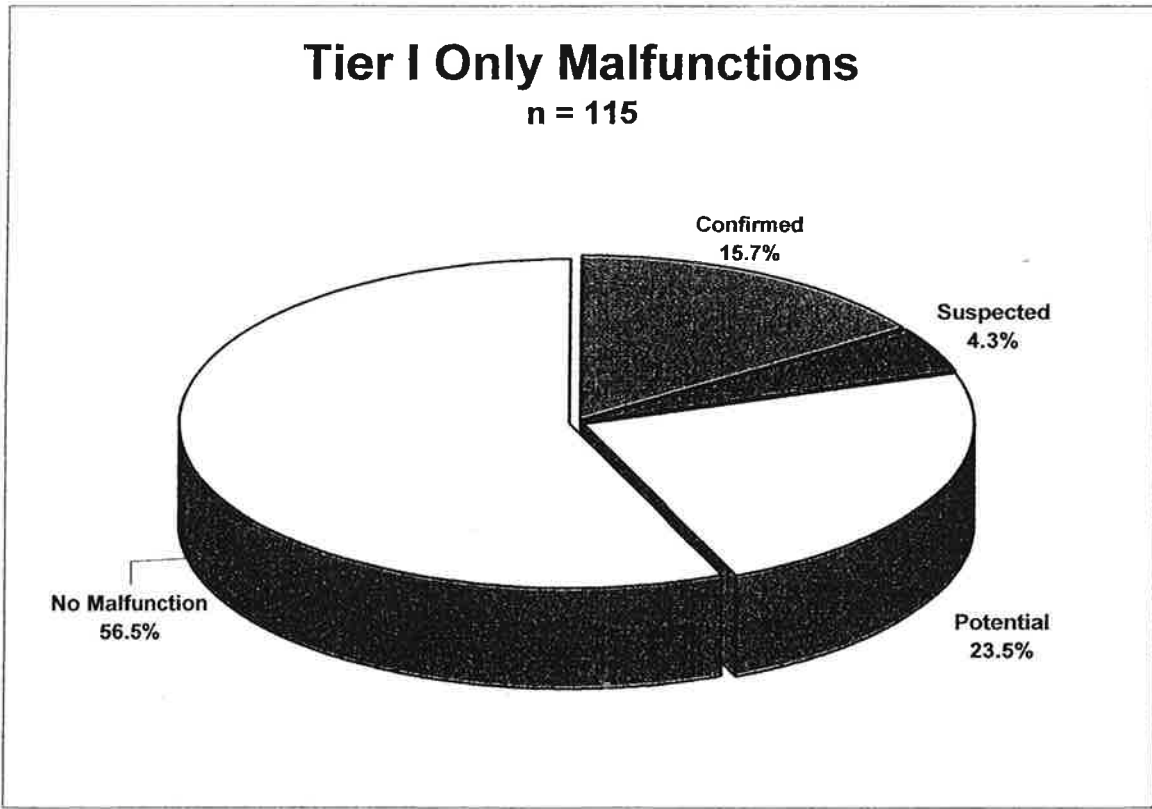


FIGURE 3-4b

Tier II Only Malfunctions

n = 25

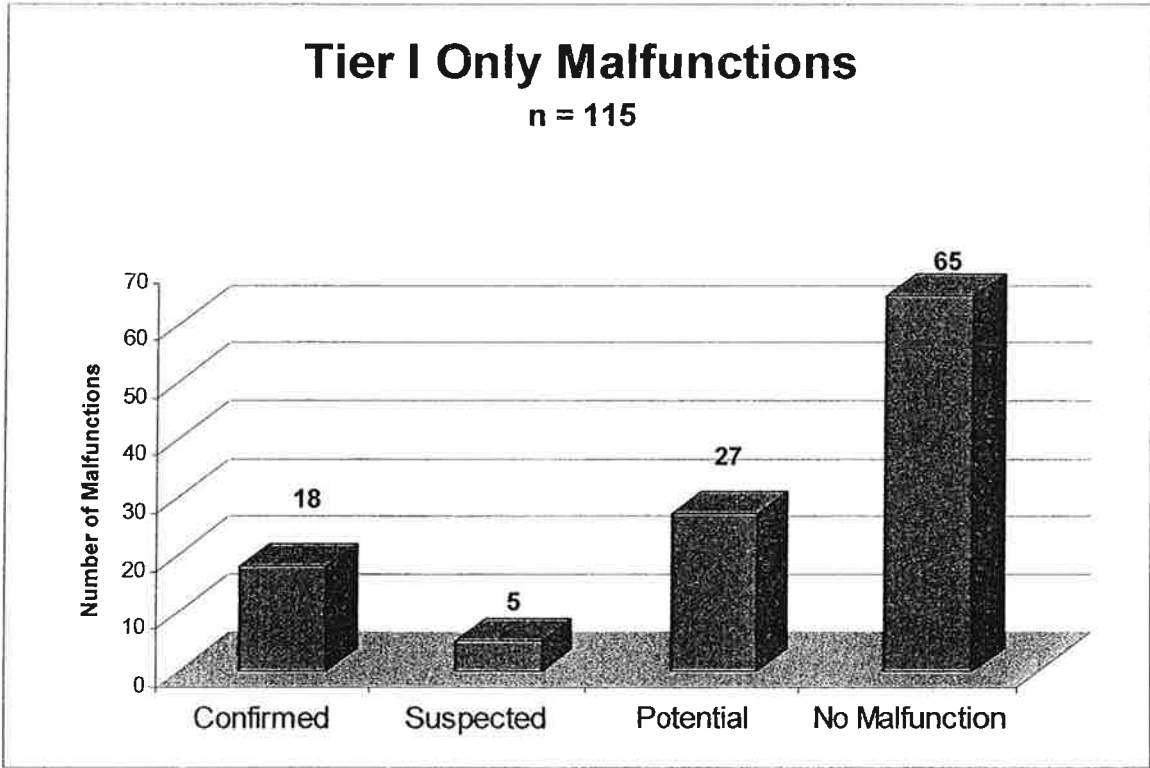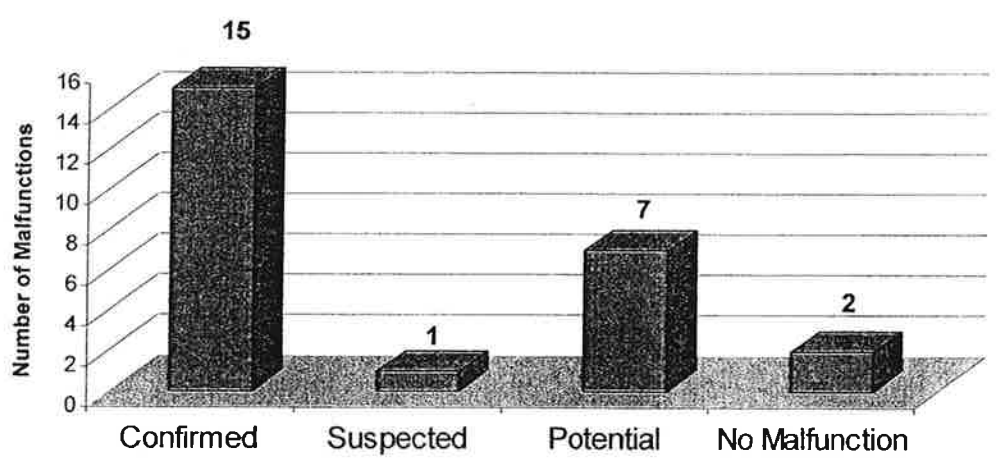

Tier II Only Malfunctions

n = 25


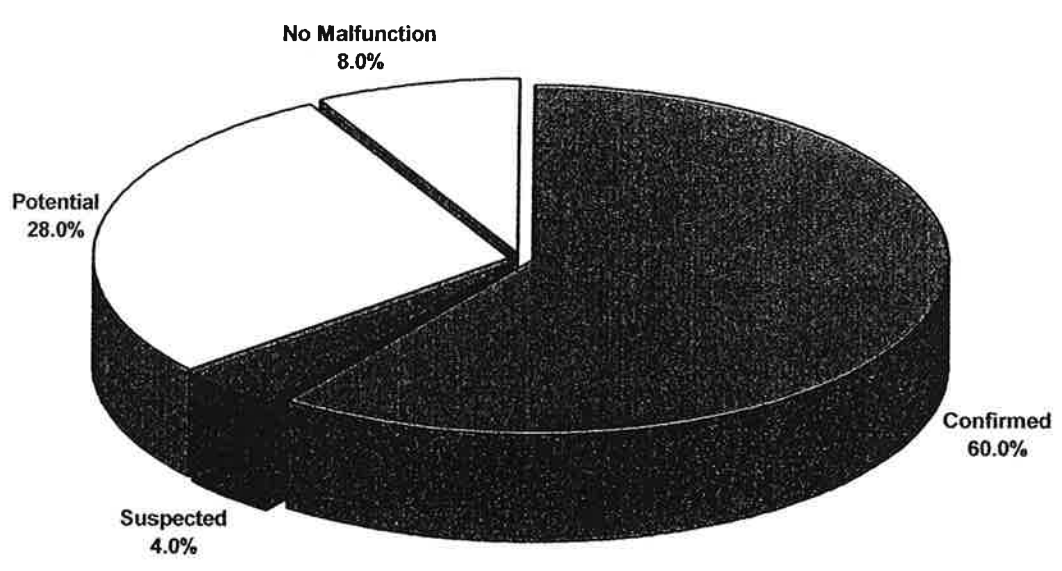


FIGURE 3-4c

**FIGURE 3-5
DRINKING WATER TEST RESULTS**

Coliform Bacteria Test Results

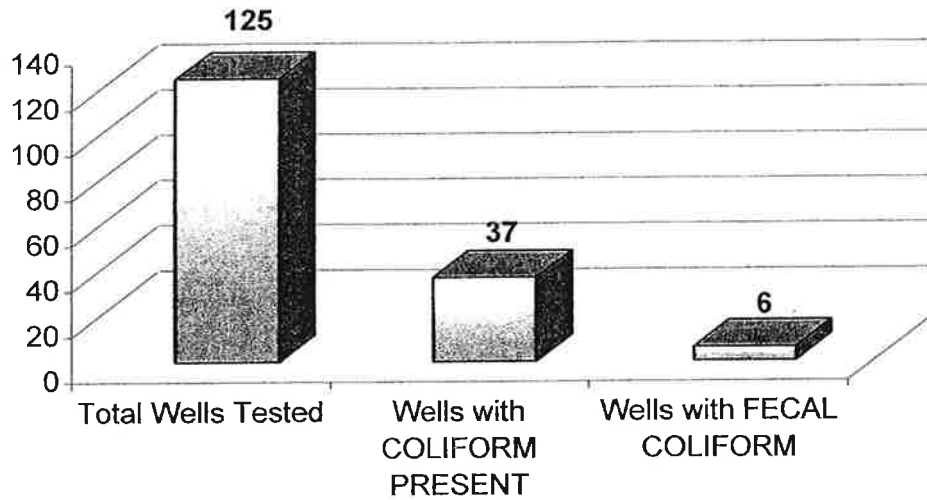

Nitrate Test Results

